

# Installation Guide

## RELATED DOCUMENTS

MasterFlow 649 Technical Data Guide



# MasterFlow® 649

## High-strength, high-temperature, high-flow epoxy grout

### HOW TO APPLY

#### SURFACE PREPARATION

1. Cure the foundation until design strength of the concrete is achieved and foundation is dry. Use the recommended procedure according to ACI 351.1R, Grouting Between Foundations and Bases for Support of Equipment and Machinery.
2. The surface to be grouted must be clean, strong, and roughened to a CSP of 5–10, following ICRI Technical Guideline No. 310.2 to permit proper bond. Do not use a bushing hammer.
3. Chamfer the edge of the concrete 45 degrees to about a 2" (51mm) width.

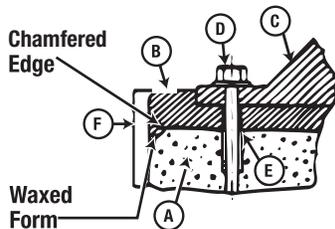


Figure 1 — Regular Equipment

#### Key:

- |                        |                            |
|------------------------|----------------------------|
| A. Concrete Foundation | D. Anchor Bolt             |
| B. Grout               | E. Anchor Bolt Sleeve Seal |
| C. Equipment Base      | F. Form                    |

4. If an anchor bolt sleeve is to be filled, be sure all water is removed. Use a siphon, vacuum pump, or rubber hose and bulb. Remove the residual moisture by either forced air or evaporation.

5. Seal the anchor bolt hole with felt, foam rubber, or other means.
6. Cover all shims and leveling screws with putty or clay to keep the grout from adhering. Use model clay, glazing putty, or anything with a putty consistency that will stick but not harden. Shims or jack pockets may be formed with wood, and forms filled with damp sand.
7. Remove shims or jack screws after the grout cures.
8. Shade the foundation from direct sunlight for at least 24 hours before and 48 hours after grouting.

#### EQUIPMENT

1. If rust scale is present, abrade the bonding surfaces of the base to be grouted; it must be free of coatings, wax, grease, or scale. Mechanical methods, such as grinding or sanding, will suffice, but do not produce as high a bond strength as sandblasting.
2. Primer should be used ONLY when a long delay between cleaning and grouting could allow excessive rusting or contamination. If the base must be primed, use MasterEmaco ADH 1090 RS from Master Builders Solutions. If the primer has been on the surface for more than 1 month, abrade and solvent wipe it so that no residue remains.
3. The grout should come up at least 3/4" (19 mm) onto the equipment. Protect the area above it with masking tape.
4. To facilitate cleanup, wax or cover all surfaces where the grout may splash or spill.

#### FORMING

1. Protect the foundation and equipment from rain or moisture. Water will prevent grout bond and inhibit cure.
2. Seal off areas that will not be grouted.
3. Place forms no greater than 6" (152 mm) away from the edge of the individual base rail or sole-plate on the sides where the grout is not being poured. Excessive edges create thermal stress and result in excessive cracking. Formwork edges should allow enough room to accommodate pouring of the grout and accommodate a headbox, is used. Shoulders should be a maximum of 6" in width. However, this may vary depending on the application. Moderate to large-size equipment and difficult or narrow placement applications should utilize an extended head form (headbox) to create additional head pressure and to enhance placement. Consult your Master Builders Solutions representative for specific recommendations.
4. Before erecting the forms, cover them with extra-heavy coats of paste wax. Forms can be shellacked before waxing to improve release. Keep wax off concrete and steel surfaces. As an alternative to waxing, a polyethylene or other non-bondable film may be used as a release agent. The top of the form should extend at least 3/4" (19 mm) above the bottom of the rail or plate.
5. Forms must be liquid tight. Seal forms to vertical concrete surface by applying putty, foam, or caulk below top of concrete and then press form into place.

(continued)

6. Expansion joints will reduce the possibility of cracking. On multiple soleplate installations, each soleplate may be isolated. Expansion joints can be made with any material that is resistant to oils and chemicals in the environment and will not allow penetration to the concrete foundation. Oil resistant, closed-cell foam works best. For more information contact your Master Builders Solutions representative or Technical Service.

#### MIXING

1. Aggregate must be completely dry.
2. Precondition all components to 70oF (21oC) for 24 hours before using.
3. Pour the hardener (Part B) into a pail of grout resin (Part A) and stir by hand, using a spatula or paint stirring paddle, until well mixed to a uniform amber color.
4. Pour the mixed liquids into a horizontal shaft mortar mixer or a Kol type mixer without delay.
5. Add the grout aggregate, one bag at a time, and mix only until aggregate is completely wetted out to avoid air entrapment. Start the mixer just prior to adding the last bag of aggregate. Caution: Always add aggregate to the mixer after the premixed liquids have been poured in.
6. Pour the grout into a wheelbarrow or buckets for transporting to pour-site. Remove it from the wheelbarrow within 15 minutes.
7. After the pour is complete, remove uncured epoxy from the mixer, wheelbarrow and tools with soap and water or a citrus degreaser. Cured material must be removed mechanically.

#### PLACEMENT

1. Pour the grout into a wheelbarrow or buckets for transporting to pour-site. Remove it from the wheelbarrow within 15 minutes.
2. For flat bottom plates and bases, pour the grout from one side through to the other across the short dimension.
3. When grouting closed areas, prevent air entrapment by starting at one end of the form and filling the cavity completely while advancing toward the other end.
4. Masterflow 649 grout will flow, but it can be aided with pushing tools like banding straps or plywood strips. Push with long, slow strokes rather than short jabs until no air pockets remain under the frames. DO NOT VIBRATE.
5. Where grout cannot be adequately worked to fill the cavity (because of large size or limited space), a head box will greatly assist flow. Use a sturdy wooden box or sheet metal funnel about 1–2 ft (0.3–0.6 m).
6. Check frequently for leaks. Leaks do not self-seal. If not stopped, they will cause voids.
7. If a multi-pour installation is necessary, sprinkle a small amount of MasterFlow 649 aggregate on the first pour's surface as the grout solidifies. Before placement of the second pour, brush the loose aggregate from the first pour's surface. Another method is to sandblast and brush clean the first pour's surface.
8. Use expansion joints as necessary to minimize cracking. Consult Technical Service for recommendations.

#### CLEANUP

After the pour is complete, remove uncured epoxy from the mixer, wheelbarrow and tools with soap and water or a citrus degreaser. Cured material must be removed mechanically.

#### WORKING TIME

The following chart shows the working time for a fresh grout mix at various ambient temperatures. The working time begins when the hardener is added to the resin. **Do not let resin and hardener stand without adding aggregate.** This material produces an exothermic. If the material exotherms without aggregate, the temperature can cause decomposition or gassing, releasing potentially hazardous fumes. If the catalyzed resin cannot be used immediately, spread the material over a large open surface, which will allow the heat to dissipate normally. These working times assume product has been properly preconditioned for cold or hot weather use.

#### Working Time

TEMPERATURE, °F (° C)	MINUTES
90 (32)	50–60
70 (21)	90–120
50 (10)	120–150

#### COLD-WEATHER CURING

For cold weather grouting use Masterflow 640 Accelerator. Refer to the Masterflow 640 Accelerator data sheet.

1. The foundation and the equipment base will probably be cooler than room temperature unless room temperature has been constant for some time. Use the foundation and engine temperature, therefore, in estimating cure time.
2. Temperature variances between day and night, ambient and substrate or baseplate, require field judgment for assessing when the grout has cured. Cured grout should have a solid, almost metallic feel when struck with a hammer. Be sure to check as close to the base of the equipment as possible.

### HOT-WEATHER GROUTING

1. Special care must be exercised when grouting at elevated temperatures, to reduce risks of premature hardening and subsequent cracking.
2. If the packaged grout is above 90° F (32° C), chill the sealed pails of grout resin in a tub of ice or cover the pails with water-soaked burlap to cool the grout to 70° F (21° C).
3. Provide shade from direct sunlight for at least 24 hours before and 48 hours after grouting.

### COLD-WEATHER GROUTING

1. Temperatures below 60° F (16° C) make the grout stiff and hard to handle and significantly increase the cure time. The baseplate and foundation may be much cooler than room temperature. In cold weather, store materials in a warm place. For best handling, the temperature of the grout components and mixing equipment should be at least 70° F (21° C).
2. When baseplate and foundation temperatures (measured by a contact thermometer) are less than 50° F (10° C), heating of the area may be necessary.
3. If heating is required, erect an enclosure around the equipment and foundation to be grouted. Forced air or infrared heaters may be used to obtain the necessary heat to increase the baseplate and foundation temperatures to 50 to 70° F (10 to 21° C). Avoid local hot spots. Apply heat 1–2 days in advance of grouting to achieve uniform baseplate and foundation temperatures. Avoid exposure to exhaust from heating equipment. Remove heat during grout placement.
4. For temperatures from 40 to 50° F (4 to 10° C), consider using Masterflow 640 Grout Accelerator to accelerate strength development.

### FILL RATIO

- The fill ratio is the weight of aggregate compared to the combined resin and hardener components. Masterflow 649 is used at a variable fill ratio from the standard 6.75:1 ratio to as low as 5.06:1 (high-flow version).
- The standard 1.73 ft<sup>3</sup> (0.049 m<sup>3</sup>) unit of Masterflow 649 includes 188 lbs (85.2 kg) of aggregate (or four 47 lb bags). This 6.75:1 fill ratio can be reduced to as low as three bags or a 5.06:1 fill ratio yielding 1.34 ft<sup>3</sup> (0.038 m<sup>3</sup>).

- For projects requiring a fill ratio different from the standard 4 bag mix, simply determine how many bags of aggregate will be used (number of bags x number of units) and purchase the components (resin, hardener, and aggregate) separately.

### Fill Ratio Guideline

TEMPERATURE	1.73 FT3 UNIT	
	VERY THIN POURS OR VERY LONG DISTANCES	STANDARD POURS
> 90° F (> 32° C)	—	—
70 to 90° F (21 to 32° C)	Up to ½ bag	—
50 to 70° F (10 to 21° C)	½ to 1 bag	½ bag

The chart above provides guidelines for the amount of aggregate that can be removed from a 1.73 ft<sup>3</sup> unit in order to optimize flow and cost per ft<sup>3</sup>. A maximum of 12 lbs of aggregate can be removed from a 0.43 ft<sup>3</sup> unit.

### HEALTH, SAFETY AND ENVIRONMENTAL

Read, understand and follow all Safety Data Sheets and product label information for this product prior to use. The SDS can be obtained by visiting [www.master-builders-solutions.com/en-us](http://www.master-builders-solutions.com/en-us), e-mailing your request to [mbsbscst@mbcc-group.com](mailto:mbsbscst@mbcc-group.com) or calling 1(800)433-9517. Use only as directed.

**IN CASE OF EMERGENCY: Call CHEMTEL +1 (800) 255-3924 or if outside the US or Canada, +1 (813) 248-0585.**

### WASTE DISPOSAL METHOD

This product when discarded or disposed of, is not listed as a hazardous waste in federal regulations. Dispose of in a landfill in accordance with local regulations. For additional information on personal protective equipment, first aid, and emergency procedures, refer to the product Safety Data Sheet (SDS) on the job site or contact the company at the address or phone numbers given below.

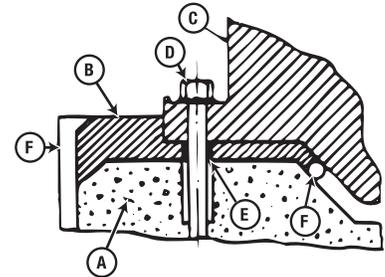


Figure 2 — Engine With Oil Pan




Figure 3 — Rail or Soleplate

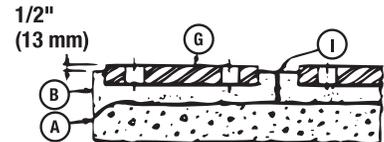


Figure 4 — Typical Rail With Expansion Joint Section

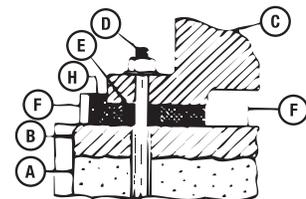


Figure 5 — Typical Epoxy Chock Application

### Key

- |                            |                      |
|----------------------------|----------------------|
| A. Concrete Foundation     | F. Form              |
| B. Grout                   | G. Soleplate or Rail |
| C. Equipment Base          | H. Shim or Chock     |
| D. Anchor Bolt             | I. Expansion Joint   |
| E. Anchor Bolt Sleeve Seal |                      |

---

**LIMITED WARRANTY NOTICE**

Master Builders Solutions Construction Systems US, LLC ("Master Builders") warrants this product to be free from manufacturing defects and to meet the technical properties on the current Technical Data Guide, if used as directed within shelf life. Satisfactory results depend not only on quality products but also upon many factors beyond our control. MASTER BUILDERS MAKES NO OTHER WARRANTY OR GUARANTEE, EXPRESS OR IMPLIED, INCLUDING WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE WITH RESPECT TO ITS PRODUCTS. The sole and exclusive remedy of Purchaser for any claim concerning this product, including but not limited to, claims alleging breach of warranty, negligence, strict liability or otherwise, is shipment to purchaser of product equal to the amount of product that fails to meet this warranty or refund of the original purchase price of product that fails to meet this warranty, at the sole option of Master Builders. Any claims concerning this product must be received in writing within one (1) year from the date of shipment and any claims not presented within that period are waived by Purchaser. MASTER BUILDERS WILL NOT BE RESPONSIBLE FOR ANY SPECIAL, INCIDENTAL, CONSEQUENTIAL (INCLUDING LOST PROFITS) OR PUNITIVE DAMAGES OF ANY KIND.

Purchaser must determine the suitability of the products for the intended use and assumes all risks and liabilities in connection therewith. This information and all further technical advice are based on Master Builders' present knowledge and experience. However, Master Builders assumes no liability for providing such information and advice including the extent to which such information and advice may relate to existing third party intellectual property rights, especially patent rights, nor shall any legal relationship be created by or arise from the provision of such information and advice. Master Builders reserves the right to make any changes according to technological progress or further developments. The Purchaser of the Product(s) must test the product(s) for suitability for the intended application and purpose before proceeding with a full application of the product(s). Performance of the product described herein should be verified by testing and carried out by qualified experts.

**FOR PROFESSIONAL USE ONLY. NOT FOR SALE TO OR USE BY THE GENERAL PUBLIC.**